



ENVIRONMENTAL PROTECTION INDUSTRIES

February 20, 2017

Mr. James Fasano
711 Madison, LLP
711 Madison Street
Oak Park, Illinois 60302

RE: Asbestos Survey Report
711 Madison Avenue
Oak Park, Illinois
EPI Project #171001

Dear Mr. Fasano:

Environmental Protection Industries (EPI) was retained by the 711 Madison, LLP to provide an asbestos survey of the building identified as 711 Madison Street, Oak Park, Cook County, Illinois. The building is a single and partial two-story commercial building with high ceilings, built on a slab on grade foundation. The asbestos survey inspection was conducted on January 17, 2017. The scope of work for this project included locating and sampling accessible suspect asbestos-containing materials throughout the site building, in accessible areas. The materials were laboratory analyzed by Polarized Light Microscopy (PLM) at a National Voluntary Laboratory Accreditation Program (NVLAP) laboratory.

PURPOSE AND SCOPE OF SERVICE

The purpose of this project was to conduct an asbestos survey of the building located on the subject property. The survey was conducted in accordance with an agreement between EPI and 711 Madison, LLP. The survey is being conducted in connection with the planned demolition of the site building. Roofing samples were no included in the scope of services.

The survey included the following:

- Review existing asbestos reports, if available;
- Survey the site buildings and identify accessible suspect asbestos-containing materials (ACM)
- The Asbestos Survey consisted of sampling accessible suspect asbestos-containing materials. The inspection was performed by Mr. John A. Best, an Illinois Department of Public Health (IDPH) licensed inspector. (Lic# 100-10353)



- Three samples of each homogeneous suspect material identified was collected to be evaluated by an accredited laboratory to determine asbestos content. Depending on quantities, additional samples were collected.

SITE CONDITIONS

The subject property is developed with a single and partial two-story commercial building. The site building is actively used as a fitness facility, and is divided into a free weights area, universal machines, dance studio, and locker rooms. The southwest portion of the former service area is not being utilized by the fitness operation, except for storage. The site building consists of approximately 27,500 square feet of floor space. The interior finishes include floor tile, ceramic tile, drywall, ceiling tile, wood floors, carpet, rubber flooring, painted concrete walls and concrete floors.

REPRESENTATIVE ASBESTOS-CONTAINING MATERIAL SURVEY

EPI representative, Mr. John A. Best Jr., an Illinois Department of Public Health (IDPH) licensed asbestos building inspector conducted the asbestos survey of the site buildings.

The building was visually inspected for the presence of building materials that are suspected to contain asbestos. Bulk samples of identified suspect ACM were collected and placed in individual sample bags for transport to a National Voluntary Laboratory Accreditation Program (NVLAP)/ American Industrial Hygiene Association (AIHA) accredited laboratory for analysis. Materials visibly identified as non-asbestos (fiber glass, foam rubber, wood, etc.) were not sampled. The asbestos survey consisted of three basic procedures: 1) conducting a visual inspection of the structures; 2) identifying homogeneous areas (HAs) of suspect surfacing, thermal system insulation, and miscellaneous materials; and 3) sampling accessible, friable and non-friable suspect materials.

Prior to collecting any samples, HAs were identified and listed to develop a sampling strategy. A homogeneous sampling area can be described as one or more areas of material that are similar in appearance and texture and that have the same installation date and function. The actual number of samples collected from each homogeneous sampling area may vary, based on the type of material and the professional judgment of the inspector.

From the list of suspect homogeneous materials, a physical assessment was performed for each material on the list. A physical assessment includes evaluating the condition" assessing the potential for disturbance, and determining the friability of each material. Friability is a term used to describe the ease in which a building material inherently lends itself to disturbance. By definition, "friable" materials are those that can be crumbled or reduced to powder by hand pressure when dry. Each material on the list was further classified into one of three categories, which have specific sampling requirements for each category.



Surfacing Materials:

Surfacing material refers to spray-applied or troweled surfaces such as plaster ceilings and walls, fireproofing, textured paints, textured plasters and spray-applied acoustical surfaces.

Thermal System Insulation:

Refers to insulation used to inhibit heat gain or loss on pipes, boilers, tanks, ducts, and various other building components.

Miscellaneous Materials:

Refers to friable and non-friable products and materials that do not fit in any of the above two categories such as resilient floor covering, baseboards, mastics, adhesives, roofing material, caulking, glazing, and siding. This category also contains wallboard and ceiling tile.

All confirmed ACMs were then assessed by their condition as good (intact), fair (damaged), or poor (significantly damaged) per Title 40 Code of Federal Regulations Part 763. Material with localized significant damage was also assessed as poor when observed.

Sampling Strategy

The asbestos inspection was conducted according to NESHAP guidelines using a minimum number of samples collected for each HA, which also meets the sampling requirements found in 29 CFR 1926.1101.

Sample collection depends on the category that the HA falls into and the amount of material present, as follows:

If the analytical results indicated that all the samples collected per HA did not contain asbestos, then the HA (material) would be considered a non-ACM. However, if the analytical results of one or more of the samples collected per HA indicate that asbestos is present in quantities of greater than 1 percent asbestos by weight (as defined by EP A), all of the HA (material) would be treated as ACM regardless of any other analytical result. Material, which can visually be determined to be non-asbestos (i.e. fibrous glass, foam, rubber, etc.) by the accredited inspector are not required to be sampled.

Miscellaneous materials require adequately representative sampling, which is typically done by collecting from one to nine samples per material. Inspectors typically rely on other survey observations such as, condition, friability, and quantity of material to determine which would be a sufficient amount of samples to accurately evaluate the presence or absence of asbestos fiber content.

Actual collection of a bulk asbestos sample involves physically removing a small piece of material and placing it in a sealed, airtight container/bag. Sample containers are marked with a unique identification number, which is also noted in the field notes.



Suspect Asbestos-Containing Material

A total of twenty-one (21) homogenous materials were identified which resulted in a total of fifty-seven (57) samples being tested. The bulk asbestos samples were analyzed by Polarized Light Microscopy (PLM) based on the number of distinct layers (materials) associated with each bulk sample and instructing the lab to "Stop at First Positive." For example, floor tile and associated mastic are collected as one bulk sample, but are analyzed as two distinct materials.

Additional ACM may be present on site in inaccessible or concealed spaces. These spaces include, but are not limited to pipe chases, spaces between walls and ceilings, safe doors, door cavities, interior of mechanical components such as boiler cavities, interior ducts, etc. If future maintenance/renovation/demolition activities make these areas accessible, EPI recommends that these areas/spaces be assessed at that time to identify and confirm the presence or absence of additional ACMs. Until then, all such unidentified materials should be treated as Presumed ACM (PACM) in accordance with 29 CFR 1926.1101 and 1910.1001.

LABORATORY ANALYTICAL RESULTS

Bulk samples were analyzed by EMSL Analytical, Inc. (EMSL), located in Chicago, Illinois. The samples were tested using PLM in accordance with EPA method 600/R-93/116.

Any material that contains greater than 1 percent asbestos is considered an ACM and must be handled according to OSHA, EPA, and applicable state and local regulations.

The materials that tested positive for asbestos fiber content include the pipe insulation and mudded elbow insulation located throughout the site building and the window caulk on the older windows. EPI estimates approximately 2000 linear feet of pipe insulation and approximately 200 elbows. This estimate does not include pipes concealed above ceilings and/or within walls and pipe chases.

Copies of the laboratory analytical report and corresponding chain-of-custody are included as Attachments. Results are reported in percent asbestos by volume and indicate the types of asbestos. Other common non-asbestos components may also be noted on the analytical reports.

CONCLUSIONS AND RECOMMENDATIONS

The results of the samples collected and tested from the site building show that asbestos fibers do exist within the materials tested. These materials are required to be removed as asbestos waste if they are disturbed during planned interior demolition activities or if the building is proposed for demolition.

Prior to the demolition of the site building the roofing systems will need to be sampled.



ASSUMPTIONS AND LIMITATIONS

The results, findings, conclusions and recommendations expressed in this report are based only on conditions that were noted during the January 17, 2017, EPI inspection of the building.


The selection of sample locations and frequency of sampling was based on EPI observations and the assumption that like materials in the same area are homogeneous in content.

The report is designed to aid the building owner, architect, construction manager, general contractors, and potential asbestos or lead abatement contractors in locating ACM. Under no circumstances is the report to be utilized as a bidding document or as a project specification document since it does not have all the components required to serve as an Asbestos Project Design document or an Abatement Work Plan.

Our professional services have been performed, our findings obtained, and our conclusions and recommendations were prepared in accordance with customary principles and practices in the fields of environmental science and engineering. This statement is in lieu of other statements either expressed or implied.

If you have any questions, please call and let us know how we may be of further service.

Sincerely,
Environmental Protection Industries

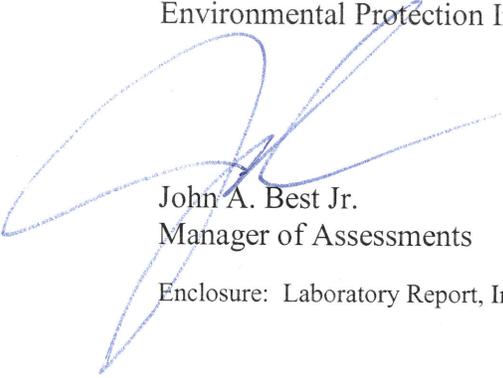

John A. Best Jr.
Manager of Assessments

Enclosure: Laboratory Report, Inspectors License



EMSL Analytical, Inc.

4140 Litt Drive Hillside, IL 60162
Tel/Fax: (773) 313-0099 / (773) 313-0139
<http://www.EMSL.com> / chicagolab@emsl.com

EMSL Order: 261700407
Customer ID: ENPI63
Customer PO: 171001
Project ID:

Attention: John Best
Environmental Protection Industries
16650 S Canal Street
South Holland, IL 60473

Phone: (708) 225-1115
Fax: (708) 225-1117
Received Date: 01/17/2017 1:51 PM
Analysis Date: 01/20/2017
Collected Date:

Project: 171001

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
OP-1 261700407-0001	PIPE INS	Gray Fibrous Homogeneous		50% Non-fibrous (Other)	50% Chrysotile
OP-2 261700407-0002	PIPE INS				Positive Stop (Not Analyzed)
OP-3 261700407-0003	PIPE INS				Positive Stop (Not Analyzed)
OP-4 261700407-0004	ELBOW INS	Gray Non-Fibrous Homogeneous		70% Non-fibrous (Other)	30% Chrysotile
OP-5 261700407-0005	ELBOW INS				Positive Stop (Not Analyzed)
OP-6 261700407-0006	ELBOW INS				Positive Stop (Not Analyzed)
OP-7-Floor Tile 261700407-0007	GREY 12X12 FT/MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-7-Mastic 261700407-0007A	GREY 12X12 FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-8-Floor Tile 261700407-0008	GREY 12X12 FT/MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-8-Mastic 261700407-0008A	GREY 12X12 FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-9-Floor Tile 261700407-0009	GREY 12X12 FT/MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-9-Mastic 261700407-0009A	GREY 12X12 FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-10-Drywall 261700407-0010	DRYWALL/COMP	White Non-Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (Other)	None Detected
OP-10-Joint Compound 261700407-0010A	DRYWALL/COMP	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-11 261700407-0011 No Drywall present.	DRYWALL/COMP	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-12-Drywall 261700407-0012	DRYWALL/COMP	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected

Initial report from: 01/20/2017 15:46:10



EMSL Analytical, Inc.

4140 Litt Drive Hillside, IL 60162
Tel/Fax: (773) 313-0099 / (773) 313-0139
<http://www.EMSL.com> / chicagolab@emsl.com

EMSL Order: 261700407
Customer ID: ENPI63
Customer PO: 171001
Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
OP-12-Joint Compound <small>261700407-0012A</small>	DRYWALL/COMP	White Non-Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
OP-13 <small>261700407-0013</small>	PYROBAR WALL MATERIAL	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-14 <small>261700407-0014</small>	PYROBAR WALL MATERIAL	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-15 <small>261700407-0015</small>	PYROBAR WALL MATERIAL	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-16-Floor Tile <small>261700407-0016</small>	BEIGE 12X12 FT/MAS	Beige Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-16-Mastic <small>261700407-0016A</small>	BEIGE 12X12 FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-17-Floor Tile <small>261700407-0017</small>	BEIGE 12X12 FT/MAS	Beige Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-17-Mastic <small>261700407-0017A</small>	BEIGE 12X12 FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-18-Floor Tile <small>261700407-0018</small>	BEIGE 12X12 FT/MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-18-Mastic <small>261700407-0018A</small>	BEIGE 12X12 FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-19-Floor Tile <small>261700407-0019</small>	GREY 12X12 FT /MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-19-Mastic <small>261700407-0019A</small>	GREY 12X12 FT /MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-20-Floor Tile <small>261700407-0020</small>	GREY 12X12 FT /MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-20-Mastic <small>261700407-0020A</small>	GREY 12X12 FT /MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-21-Floor Tile <small>261700407-0021</small>	GREY 12X12 FT /MAS	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-21-Mastic <small>261700407-0021A</small>	GREY 12X12 FT /MAS	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-22 <small>261700407-0022</small>	2X2 CT	White Fibrous Homogeneous	40% Cellulose 40% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
OP-23 <small>261700407-0023</small>	2X2 CT	White Fibrous Homogeneous	40% Cellulose 40% Min. Wool	10% Perlite 10% Non-fibrous (Other)	None Detected
OP-24 <small>261700407-0024</small>	2X2 CT	Tan Fibrous Homogeneous	40% Cellulose 40% Min. Wool	15% Perlite 5% Non-fibrous (Other)	None Detected

Initial report from: 01/20/2017 15:46:10



EMSL Analytical, Inc.

4140 Litt Drive Hillside, IL 60162
Tel/Fax: (773) 313-0099 / (773) 313-0139
<http://www.EMSL.com> / chicagolab@emsl.com

EMSL Order: 261700407
Customer ID: ENPI63
Customer PO: 171001
Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
OP-25-Ceiling Tile <small>261700407-0025</small>	12X12 CT/ADHESIVE	White Fibrous Homogeneous	98% Cellulose	2% Non-fibrous (Other)	None Detected
OP-25-Adhesive <small>261700407-0025A</small>	12X12 CT/ADHESIVE	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-26-Ceiling Tile <small>261700407-0026</small>	12X12 CT/ADHESIVE	White Fibrous Homogeneous	98% Cellulose	2% Non-fibrous (Other)	None Detected
OP-26-Adhesive <small>261700407-0026A</small>	12X12 CT/ADHESIVE	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-27-Ceiling Tile <small>261700407-0027</small>	12X12 CT/ADHESIVE	Brown Fibrous Homogeneous	90% Cellulose	10% Non-fibrous (Other)	None Detected
OP-27-Adhesive <small>261700407-0027A</small>	12X12 CT/ADHESIVE	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-28-Cove Base <small>261700407-0028</small>	COVEBASE/ADHESI VE	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-28-Adhesive <small>261700407-0028A</small>	COVEBASE/ADHESI VE	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-29-Cove Base <small>261700407-0029</small>	COVEBASE/ADHESI VE	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-29-Adhesive <small>261700407-0029A</small>	COVEBASE/ADHESI VE	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-30-Cove Base <small>261700407-0030</small>	COVEBASE/ADHESI VE	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-30-Adhesive <small>261700407-0030A</small>	COVEBASE/ADHESI VE	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-31 <small>261700407-0031</small>	EXTERIOR WINDOW CAULK	Gray Non-Fibrous Homogeneous		95% Non-fibrous (Other)	5% Chrysotile
OP-32 <small>261700407-0032</small>	EXTERIOR WINDOW CAULK				Positive Stop (Not Analyzed)
OP-33 <small>261700407-0033</small>	EXTERIOR WINDOW CAULK				Positive Stop (Not Analyzed)
OP-34-Floor Tile <small>261700407-0034</small>	12X12 WHITE FT/MAS	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-34-Mastic <small>261700407-0034A</small>	12X12 WHITE FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-35-Floor Tile <small>261700407-0035</small>	12X12 WHITE FT/MAS	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-35-Mastic <small>261700407-0035A</small>	12X12 WHITE FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected

Initial report from: 01/20/2017 15:46:10



EMSL Analytical, Inc.

4140 Litt Drive Hillside, IL 60162
Tel/Fax: (773) 313-0099 / (773) 313-0139
<http://www.EMSL.com> / chicagolab@emsl.com

EMSL Order: 261700407
Customer ID: ENPI63
Customer PO: 171001
Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
OP-36-Floor Tile <i>261700407-0036</i>	12X12 WHITE FT/MAS	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-36-Mastic <i>261700407-0036A</i>	12X12 WHITE FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-37-Floor Tile <i>261700407-0037</i>	12X12 YELLOW FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-37-Mastic <i>261700407-0037A</i>	12X12 YELLOW FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-38-Floor Tile <i>261700407-0038</i>	12X12 YELLOW FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-38-Mastic <i>261700407-0038A</i>	12X12 YELLOW FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-39-Floor Tile <i>261700407-0039</i>	12X12 YELLOW FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
OP-39-Mastic <i>261700407-0039A</i>	12X12 YELLOW FT/MAS	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected

Analyst(s)

Christine Stouffer (18)
Dahlia Zyhowski (38)

James Hahn, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Hillside, IL NVLAP Lab Code 200399-0

Initial report from: 01/20/2017 15:46:10



Asbestos Chain of Custody

EMSL Order Number (Lab Use Only):

261700407

EMSL ANALYTICAL, INC.
4140 LITT DRIVE
HILLSIDE, IL 60162
PHONE: 773-313-0099
FAX: 773-313-0139

Company Name: <u>EPI</u>		EMSL Customer ID:	
Street: <u>1665 S CANAL</u>		City: <u>South Haven</u>	State/Province: <u>IL</u>
Zip/Postal Code: <u>60473</u>	Country: <u>US</u>	Telephone #: <u>708 225 1115</u>	Fax #: <u>1117</u>
Report To (Name): <u>John Best</u>		Please Provide Results: <input type="checkbox"/> Fax <input checked="" type="checkbox"/> Email	
Email Address: <u>johnbest@environmental.epi.com</u>		Purchase Order:	
Project Name/Number: <u>171001</u>		EMSL Project ID (Internal Use Only):	
U.S. State Samples Taken: <u>IL</u>		CT Samples: <input type="checkbox"/> Commercial/Taxable <input type="checkbox"/> Residential/Tax Exempt	

EMSL-Bill to: Same Different - If Bill to is Different note instructions in Comments**
Third Party Billing requires written authorization from third party

Turnaround Time (TAT) Options* - Please Check

- 3 Hour 6 Hour 24 Hour 48 Hour 72 Hour 96 Hour 1 Week 2 Week

*For TEM Air 3 hr through 6 hr, please call ahead to schedule. *There is a premium charge for 3 Hour TEM AHERA or EPA Level II TAT. You will be asked to sign an authorization form for this service. Analysis completed in accordance with EMSL's Terms and Conditions located in the Analytical Price Guide.

<p>PCM - Air <input type="checkbox"/> Check if samples are from NY</p> <p><input type="checkbox"/> NIOSH 7400</p> <p><input type="checkbox"/> w/ OSHA 8hr. TWA</p>	<p>TEM - Air <input type="checkbox"/> 4-4.5hr TAT (AHERA only)</p> <p><input type="checkbox"/> AHERA 40 CFR, Part 763</p> <p><input type="checkbox"/> NIOSH 7402</p> <p><input type="checkbox"/> EPA Level II</p> <p><input type="checkbox"/> ISO 10312</p>	<p>TEM - Dust</p> <p><input type="checkbox"/> Microvac - ASTM D 5755</p> <p><input type="checkbox"/> Wipe - ASTM D6480</p> <p><input type="checkbox"/> Carpet Sonication (EPA 600/J-93/167)</p>
<p>PLM - Bulk (reporting limit)</p> <p><input checked="" type="checkbox"/> PLM EPA 600/R-93/116 (<1%)</p> <p><input type="checkbox"/> PLM EPA NOB (<1%)</p> <p>Point Count</p> <p><input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1000 (<0.1%)</p> <p>Point Count w/Gravimetric</p> <p><input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1000 (<0.1%)</p> <p><input type="checkbox"/> NYS 198.1 (friable in NY)</p> <p><input type="checkbox"/> NYS 198.6 NOB (non-friable-NY)</p> <p><input type="checkbox"/> NYS 198.8 SOF-V</p> <p><input type="checkbox"/> NIOSH 9002 (<1%)</p>	<p>TEM - Bulk</p> <p><input type="checkbox"/> TEM EPA NOB</p> <p><input type="checkbox"/> NYS NOB 198.4 (non-friable-NY)</p> <p><input type="checkbox"/> Chatfield SOP</p> <p><input type="checkbox"/> TEM Mass Analysis-EPA 600 sec 2.5</p> <p>TEM - Water: EPA 100.2</p> <p>Fibers >10µm <input type="checkbox"/> Waste <input type="checkbox"/> Drinking</p> <p>All Fiber Sizes <input type="checkbox"/> Waste <input type="checkbox"/> Drinking</p>	<p>Soil/Rock/Vermiculite</p> <p><input type="checkbox"/> PLM EPA 600/R-93/116 with milling prep (<1%)</p> <p><input type="checkbox"/> PLM EPA 600/R-93/116 with milling prep (<0.25%)</p> <p><input type="checkbox"/> TEM EPA 600/R-93/116 with milling prep (<0.1%)</p> <p><input type="checkbox"/> TEM Qualitative via Filtration Prep</p> <p><input type="checkbox"/> TEM Qualitative via Drop Mount Prep</p> <p><input type="checkbox"/> Cincinnati Method EPA 600/R-04/004 - PLM/TEM (BC only)</p> <p>Other:</p> <p><input type="checkbox"/></p>

Check For Positive Stop - Clearly Identify Homogenous Group Filter Pore Size (Air Samples): 0.8µm 0.45µm

Samplers Name: John Best Samplers Signature:

Sample #	Sample Description	Volume/Area (Air) HA # (Bulk)	Date/Time Sampled
OP-1	Pipe Ins		
OP-2	↓		
OP-3			
OP-4	Elbow Ins		
OP-5	↓		

Client Sample # (s): OP-1 - OP-39 Total # of Samples: (39)

Relinquished (Client): Date: 11/17/17 Time: _____

Received (Lab): Date: 11/17/17 Time: 1351

Comments/Special Instructions: _____



EMSL ANALYTICAL, INC
LABORATORY PRODUCTS TRAINING

Asbestos Chain of Custody
EMSL Order Number (Lab Use Only).

— 407

EMSL ANALYTICAL, INC.
4140 LITT DRIVE
HILLSIDE, IL 60162
PHONE: 773-313-0099
FAX: 773-313-0139

Additional Pages of the Chain of Custody are only necessary if needed for additional sample information

Sample #	Sample Description	Volume/Area (Air) HA # (Bulk)	Date/Time Sampled
OP-6	PIPE ELBOW FITS		
OP-7	Gray 12x12 FT/MAT		
OP-8	↓		
OP-9			
OP-10	Drywall / Comp		
OP-11	↓		
OP-12			
OP-13	Pyrobar Wall Material		
OP-14	↓		
OP-15			
OP-16	Beige 12x12 FT/MAT		
OP-17	↓		
OP-18			
OP-19	Gray 12x12 FT/MAT		
OP-20	↓		
OP-21			
OP-22	2x2 CT		
OP-23	↓		
OP-24			
OP-25	12x12 CT / Adhesive		
OP-26	↓		
OP-27			
OP-28	Cons Base / Adhesive		

*Comments/Special Instructions:



**ASBESTOS
PROFESSIONAL
LICENSE**

ID NUMBER
100 - 10353

ISSUED
4/8/2016

EXPIRES
05/15/2017

JOHN A BEST JR.
4336 WESTERN AVE
WESTERN SPRINGS, IL 60558

Environmental Health

